






# February Operations Report

Alan Grooms, Operations Manager  
March 27, 2025


Madison Metropolitan Sewerage District

# February Plant Performance

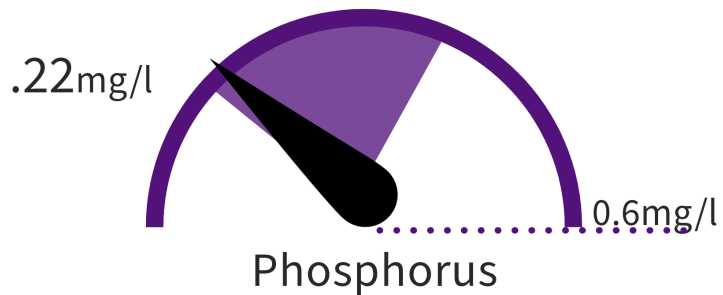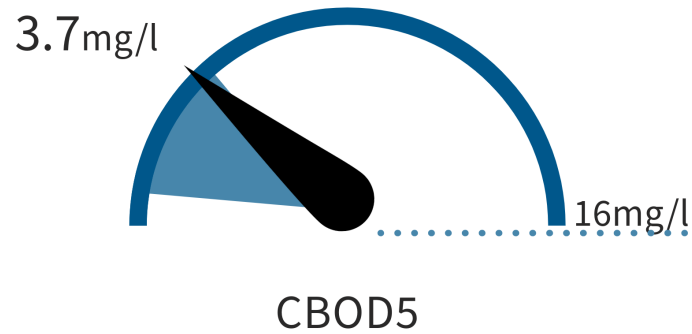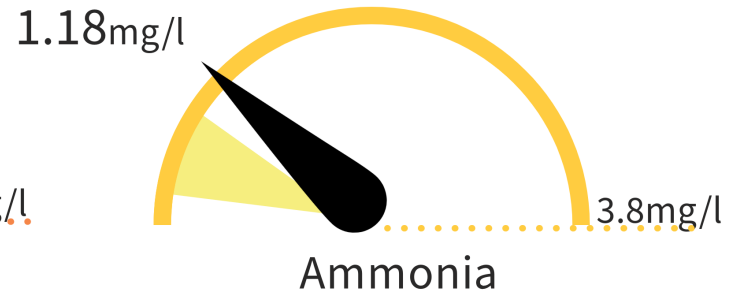



# Pump Station 4 SSO

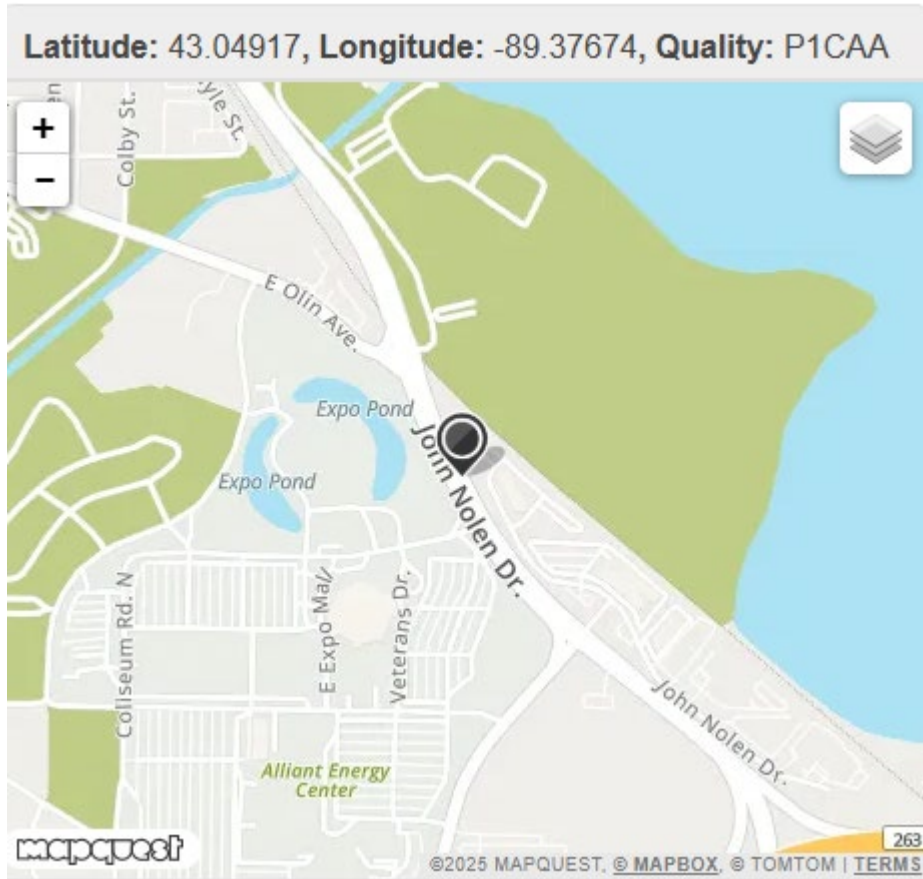

- SSO = Sewer System Overflow
- February 26, 2025 about 10:00 am
- Buried valve actuator extension snapped, valve failed in closed position
- Incident Command System activated
  - 11:35 am, ~ 500 gallons raw wastewater drained from hose, promptly cleaned up
- Notifications issued
- Station fully restored by 6:00 pm
- Valve replaced and manhole added March 17<sup>th</sup>





# Pump Station 4 SSO





# Nine Springs TFO



TFO = Treatment Facility Overflow

February 26, 2025 about 3:10 pm

Centrifuge polymer and dilution water proportions resulted in accumulation and overflow of froth from centrate well

- Stopped upon discovery of overflow
- Estimated 50 gallons cleaned up within an hour

Notifications issued

